


PLAN VIEW

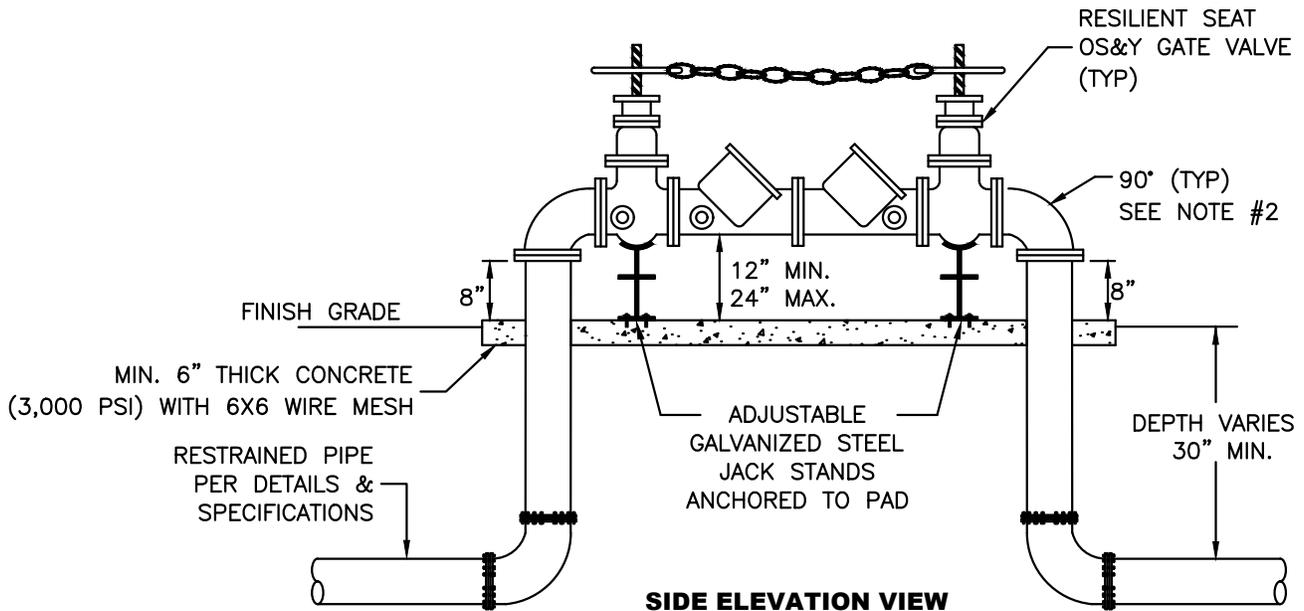

SIDE ELEVATION VIEW

NOTES:

1. ALL PIPE AND FITTINGS SHALL BE CLASS 53 DUCTILE IRON.
2. ALL UNDERGROUND FITTINGS SHALL BE RESTRAINED MECHANICAL JOINT TYPE & ALL ABOVE GROUND FITTINGS SHALL BE FLANGE JOINTS WITH FULL FACE NEOPRENE GASKETS, WITH STAINLESS STEEL BOLTS.
3. A 3/8" STAINLESS STEEL CHAIN & LOCK SHALL BE PROVIDED FOR THE VALVES AS REQUIRED BY THE SLWSD. VALVES TO BE LOCKED IN OPEN POSITION.
4. TO MAINTAIN CONTINUITY OF SERVICE DURING REPAIRS TO THE ASSEMBLY, AN ISOLATION VALVE SHALL BE PROVIDED ON THE SLWSD MAIN AND LABELED SLWSD POINT OF SERVICE.



**MINIMUM CONSTRUCTION STANDARDS FOR
ST. LUCIE WEST SERVICES DISTRICT**
450 SW UTILITY DRIVE,
PORT SAINT LUCIE, FL 34986
PHONE: (772) 340-0220

**FIRE SERVICE
BACKFLOW ASSEMBLY**

DETAIL: SLW-05

DATE: 03/2020

SCALE: N.T.S.

SHEET: 1 OF 1