


FOR 2" JUMPER CONNECTION ONLY



FOR JUMPER CONNECTIONS OF 4" OR GREATER

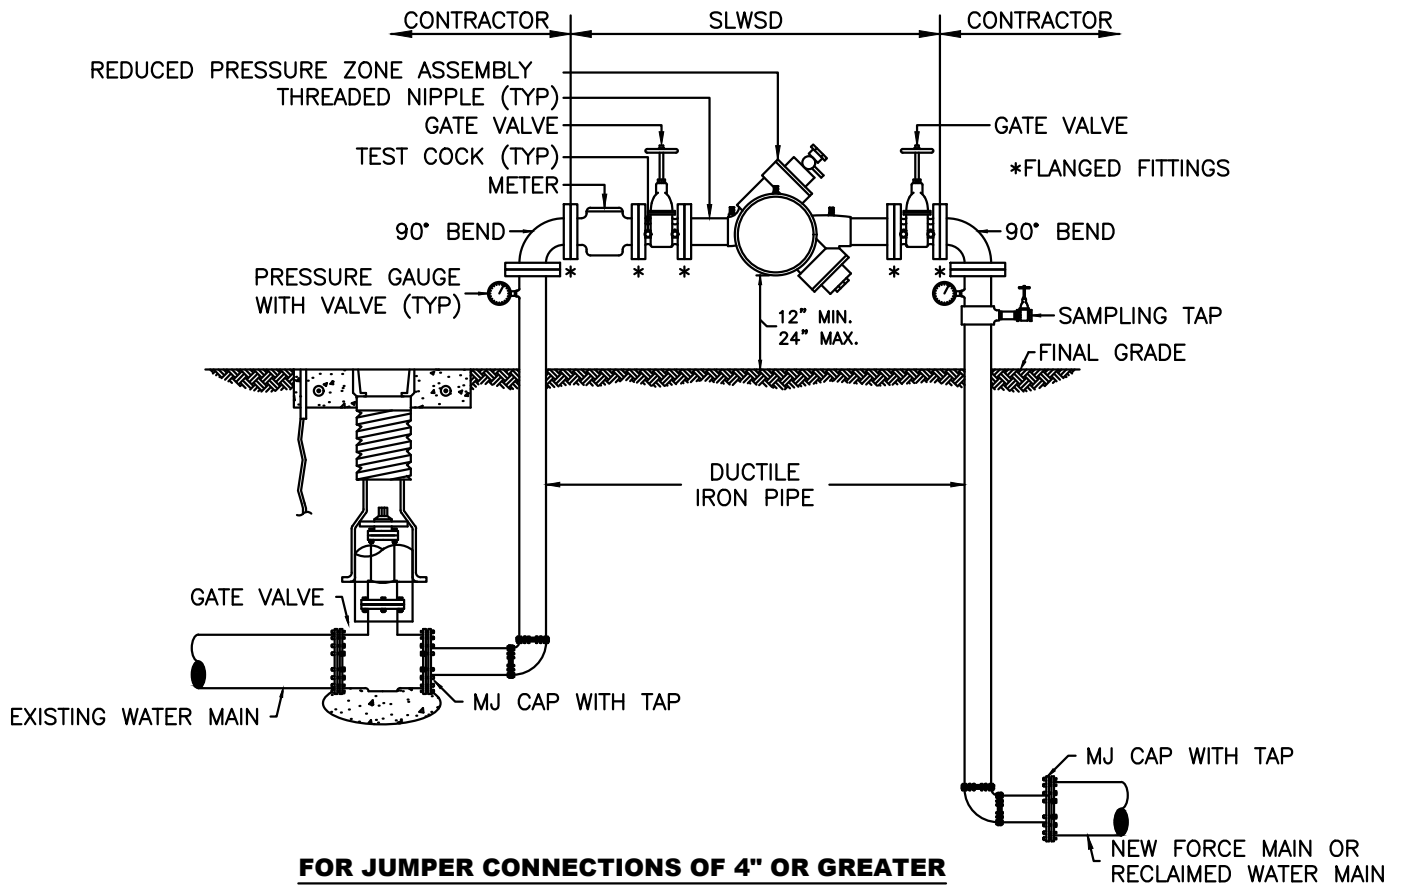

MINIMUM CONSTRUCTION STANDARDS FOR
 ST. LUCIE WEST SERVICES DISTRICT
 450 SW UTILITY DRIVE,
 PORT SAINT LUCIE, FL 34986
 PHONE: (772) 340-0220

**NON-POTABLE WATER
 TEMPORARY JUMPER
 CONNECTION**

DETAIL: SLWG-14A
DATE: 03/2020
SCALE: N.T.S.
SHEET: 1 OF 2